
BG04 Multi-circuit Power Monitor Quick Start Guide



This is a summary of how to install a Packet Power BG04 multi-circuit monitoring device.

IMPORTANT

- 1. Installation should be conducted by a qualified professional according to local electrical codes.
- 2. Protective equipment should be used when handling a current transducer (CT) on a live conductor.
- 3. Do not make adjustments to the BG04's internal wiring.
- 4 If you believe the BG04, CTs, or leads have been damaged, do not attempt to repair or use them.

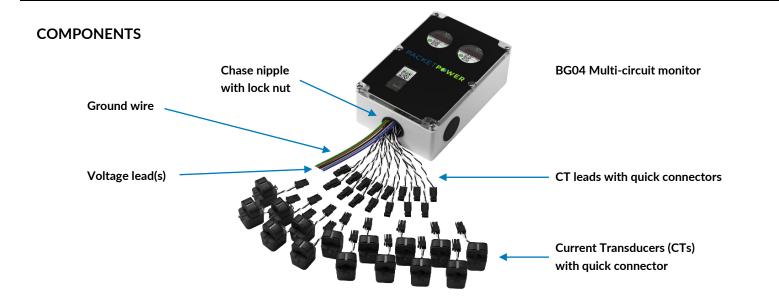

TOOLS NEEDED

12" adjustable wrench

12" adjustable claw pump pliers

#2 Phillips screwdriver (minimum 4" shaft)

#5 drill bit

#5 screws

- -- to tighten chase nipple
- -- to tighten lock nut around chase nipple
- -- to remove device cover if needed
- -- to make mounting holes in wall
- -- to attach mounting tabs to wall

INSTALLATION STEPS

See next page for more detail by step.

The BG04 does not need to be configured prior to use.



Run CT leads from the BG04 to device being monitored

3 Connect CTs to the conductors

Connect CT tails to the CT leads coming from the BG04

Run the voltage leads to the voltage source and connect by line and ground

Once power is supplied, the BG04 will automatically begin to transmit data.




SERIOUS OR FATAL HAZARD WARNING:

Disconnect power prior to installation and ensure installation is done by a qualified person according to local electrical codes. Detailed information can be found at packetpower.com/support.

1 Mount BG04

- Place near enough to the equipment being monitored to ensure voltage and CT lead lengths will fit
- Place within 30 feet of Packet Power Ethernet Gateway or other Packet Power monitoring device
- Use attached mounting tabs for wall mount or use included chase nipple to install directly onto equipment
- Mounting tabs have #0.18 hole

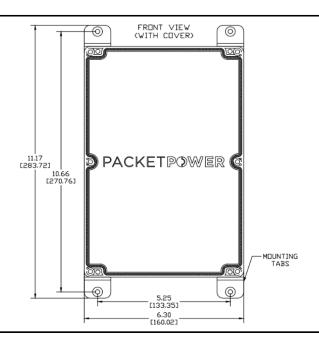

- 2 Run CT leads from the BG04 to device being monitored
- 3 Connect CTs to the conductors
- Consult the CT Specification Sheet for correct CT orientation



- 4 Connect CT tails to the CT leads coming from the BG04
- CTs from full-power meters will be labeled L1, L2, L3; ensure they are placed on the proper phase
- CTs from current-only meters will be labeled CT1, CT2, CT3, ... and are not phase-specific
- 5 Run the voltage leads to the voltage source and connect by line and ground
- If there are multiple voltage sources, the voltage leads will be labeled accordingly
- Ensure adequate over-current protection is provided

Once power is supplied, the BG04 will automatically begin to transmit data.

2716 Summer St. NE Minneapolis, MN 55413 USA



Ph (877) 560-8770 ext 2 www.packetpower.com