


CT-XH150-xxxx-S-500M Current Transformer

This document is intended to be used with the Packet Power 3-Phase Power Monitoring Module User's Manual. Please refer to it for important information.

Technical Specifications

Model	Rated Input	Maximum Load
CT-XH150-800-S-500MX	800A AC	960A AC
CT-XH150-1000-S-500MX	1000A AC	1200A AC
CT-XH150-1200-S-500MX	1200A AC	1440A AC
CT-XH150-1600-S-500MX	1600A AC	1920A AC
CT-XH150-2000-S-500MX	2000A AC	2400A AC
CT-XH150-3000-S-500MX	3000A AC	3600A AC
CT-XH150-4000-S-500MX	4000A AC	4800A AC

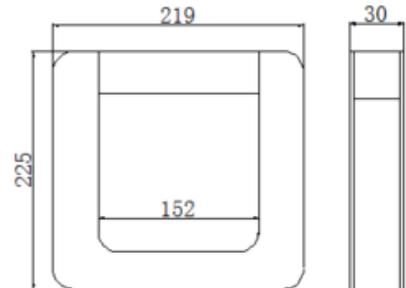


CT Type: Split Core
Accuracy: +/- 1.0%
Leads: 500 mm 24AWG 600V wire with connector

Installation Notes

- Power down the circuit prior to installation. *Warning: If it is not possible to power down the circuit, always treat CT leads as though they could carry line voltages or higher.*
- Open the split core CT by opening the latch on the side of the CT (figure 1).
- Position the CT on the conductor such that **the CT leads face toward the source** and away from the load (figure 2).
- Close the CT and ensure the latch has clicked into place.
- Be sure to connect each CT to the correct phase on the monitoring unit (refer to Packet Power's wiring diagram for the circuit type that relates to your application) by attaching the CT leads to the monitoring module using the CT connector harness (figure 3).
- Connect the CT to the CT connector harness using the polarized connector.



Figure 1

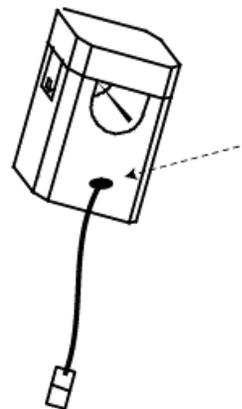

The side of the CT with the leads faces the source and away from the load.

Figure 2

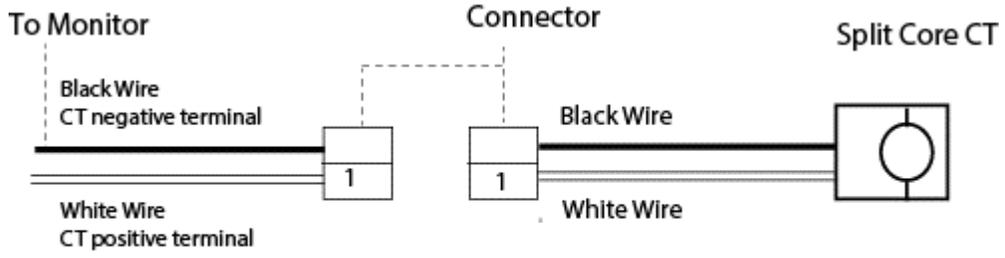


Figure 3